


LOGGED AREA INFORMATION		TOTAL LOAD LOGGED	AVERAGE WEEKLY LIGHTS ON			AVERAGE WEEKLY OCCUPIED			%SAVINGS
AREA TYPE	QTY	WATTS	PEAK	OFF-PK	TOTAL HRS	PEAK	OFF-PK	TOTAL HRS	
PRIVATE OFFICE (PO)	20	332	38.25	0.00	38.25	29.50	0.00	29.50	22.88%
MEETING ROOMS (M)	4	445	19.94	0.00	19.94	15.38	0.00	15.38	22.87%
OPEN SPACE (OS)	33	812	57.39	0.00	57.39	37.91	0.00	37.91	33.94%
RESTROOM (R)	22	201	85.00	0.00	85.00	25.74	0.00	25.74	69.72%
STORAGE (S)	10	398	34.03	0.00	34.03	18.23	0.00	18.23	46.43%
HALLWAY (H)	50	910	90.01	0.00	90.01	53.37	0.00	53.37	40.71%
CLASSROOM (CR)	85	1182	36.11	0.00	36.11	31.32	0.00	31.32	13.27%
GYM (G)	5	4746	73.30	0.00	73.30	44.19	0.00	44.19	39.71%
CAFETERIA (CF)	6	3896	94.17	0.00	94.17	46.44	0.00	46.44	50.68%
LIBRARY (LI)	5	3507	39.05	0.00	39.05	36.42	0.00	36.42	6.73%
TOTALS	240	254229	57.77	0.00	57.77	38.44	0.00	38.44	33.46%

KEY

- Average Lights ON Hours
- Average Occupied Hours

ELECTRICITY DATA

PEAK \$0.100 kWhr
OFF PEAK N/A
DEMAND \$1.000 kW

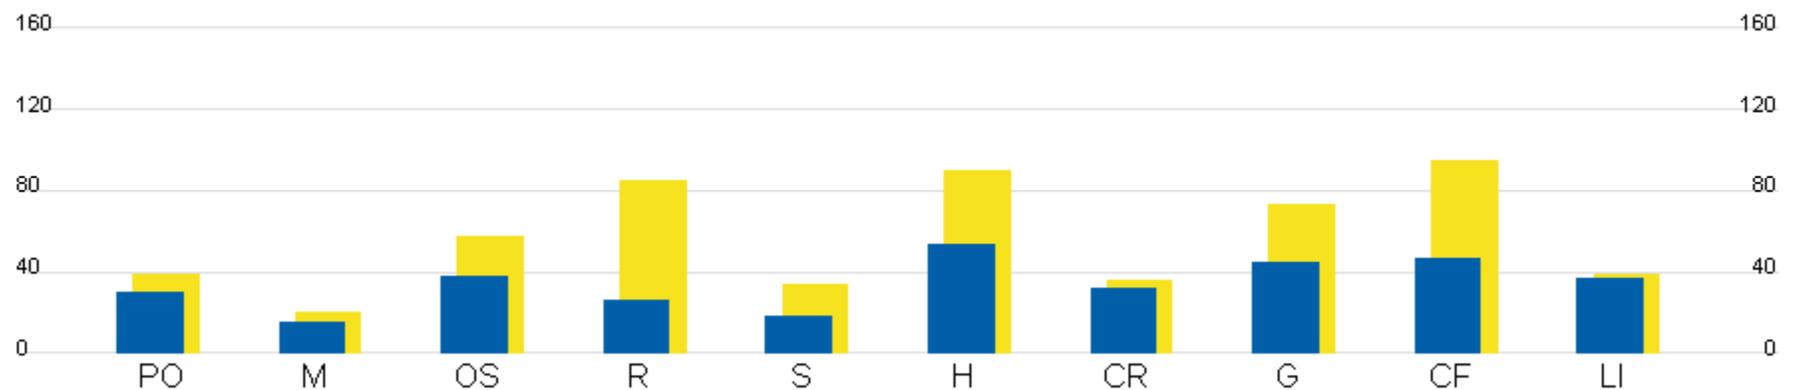



HOURS / WEEK BY AREA TYPE

PREPARED BY PRACTICAL ENERGY SOLUTIONS
1.877.276.1312 • PEScontrols.com
(c)2012 Practical Energy Solutions, LLC
Page 1 of 480




Boys RR (Continued)

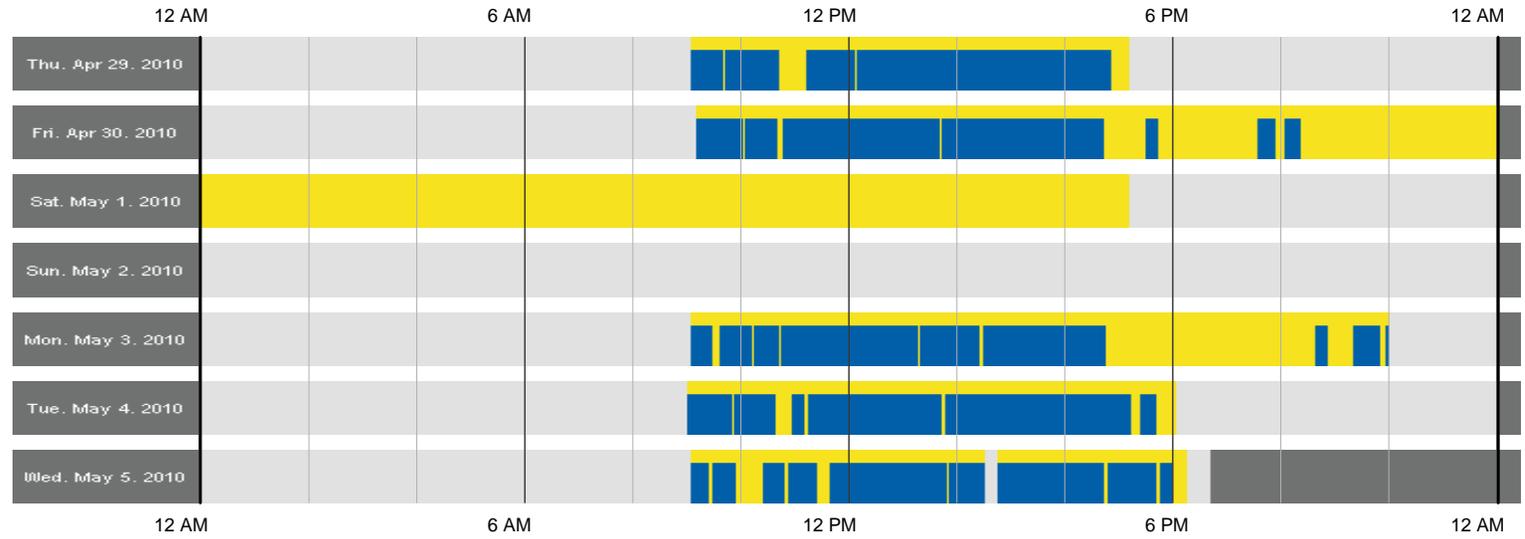

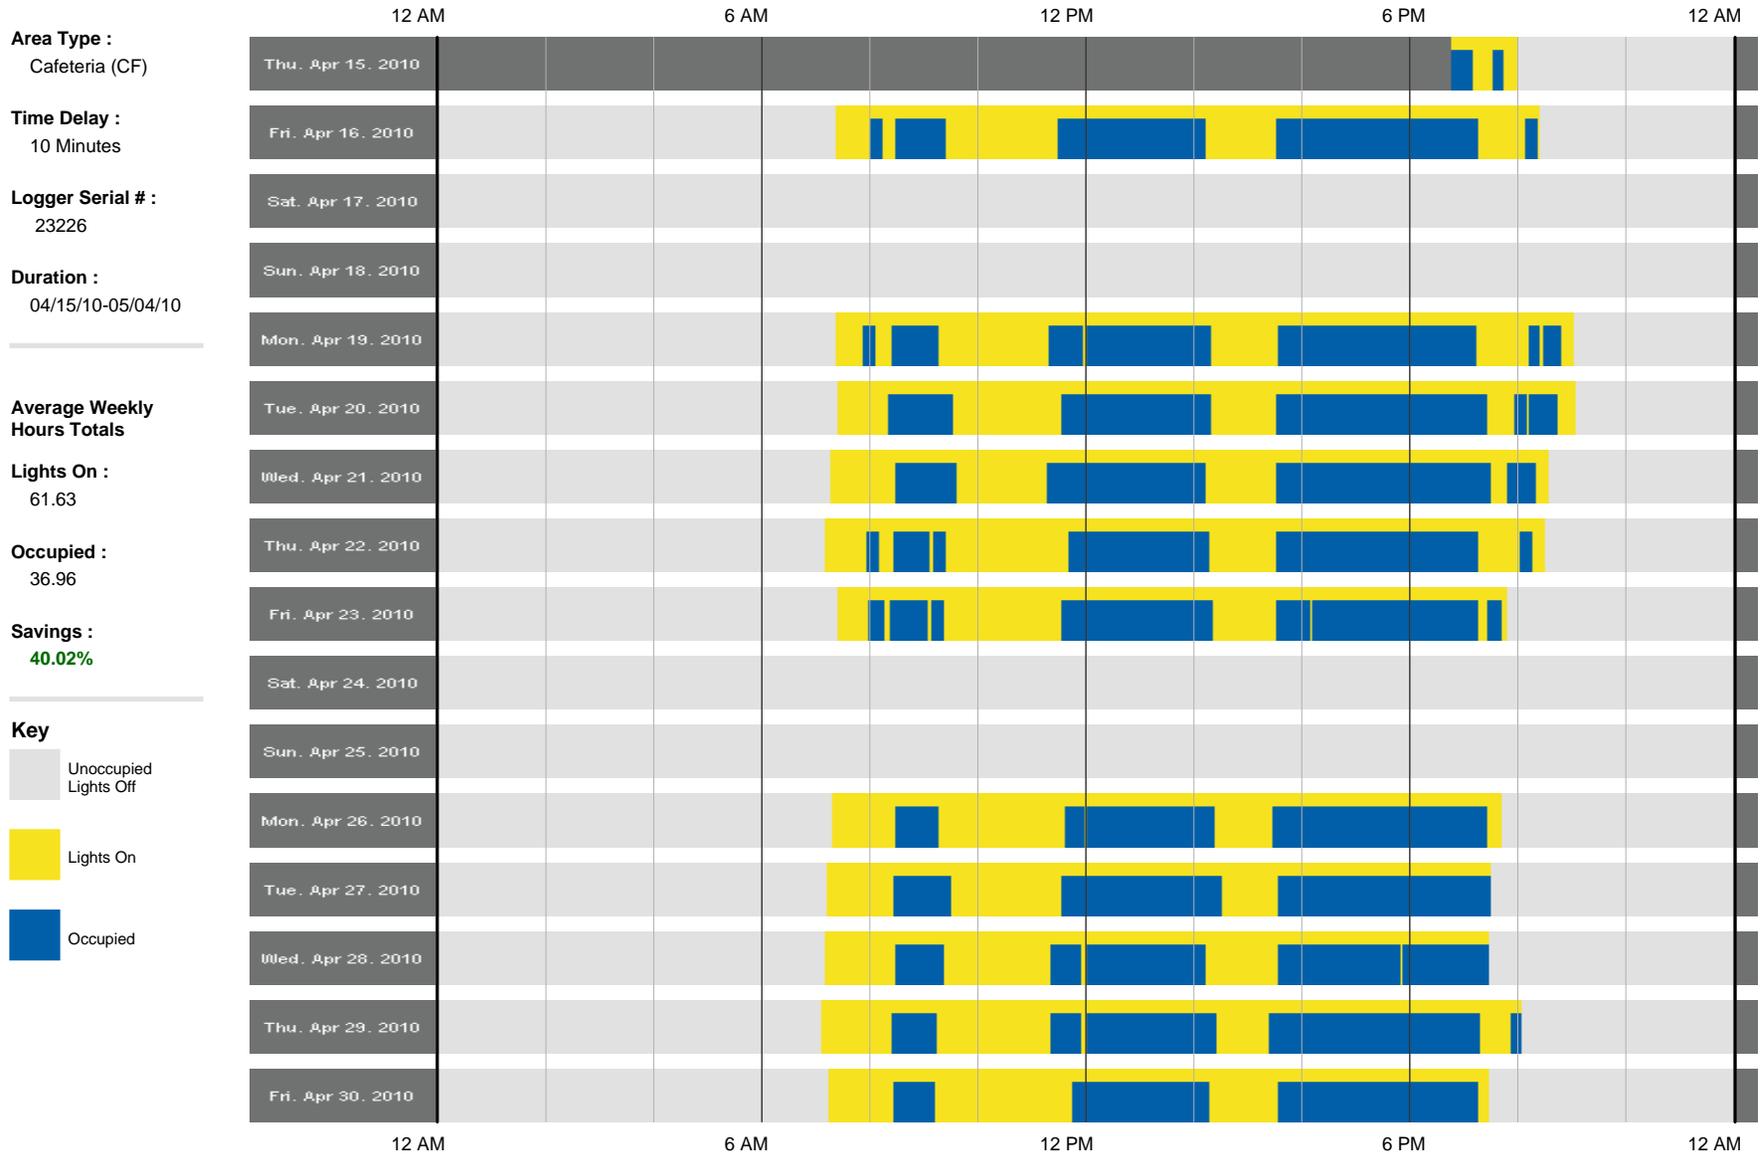

Cafeteria (Continued)

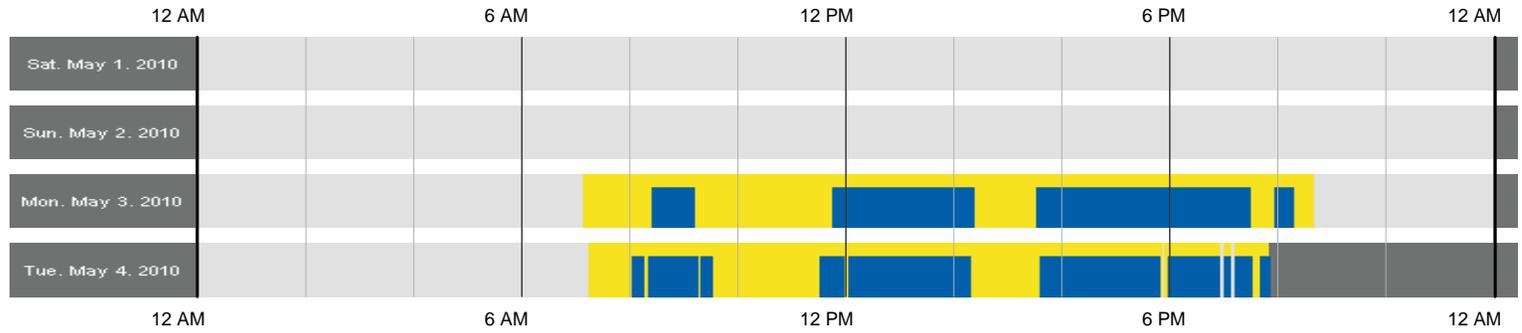



Gym (Continued)

